



4' x 8'-(8) FASTENERS/BD.

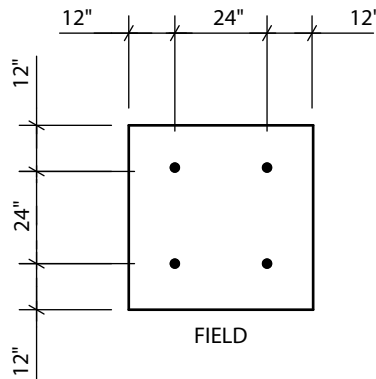

4' x 4'-(4) FASTENERS/BD.

1. MINIMUM THICKNESS OF INSULATION SHALL BE 1.5"
2. FACTORY MUTUAL APPROVED HEAVY DUTY FASTENERS (#14 MIN.) AND STEEL PLATES
3. CONSULT ATLAS TECHNICAL DEPARTMENT FOR HIGH WIND APPLICATIONS
4. MINIMUM RECOMMENDED FASTENING PATTERN
5. REFER TO LOSS PREVENTION DATA SHEET 1-29 OR CONSULT THE ROOF SYSTEM MANUFACTURER FOR PERIMETER AND CORNER ENHANCEMENT RECOMMENDATIONS

DRAWING NO. <h2 style="margin: 0;">FA/GB</h2>	ACFoam Composite/GB ADHERED SINGLE PLY SYSTEMS				
REVISION 0	ISSUE DATE 7-16-02	SCALE N.T.S.	DRAWN BY P.J.W.		